

Likely fire performance of a loadbearing framed wall system lined with FireCrunch MBE-10 boards with cavity insulation

Assessment Report

Author: Brett Roddy
Report number: FCO-3165a
Date: 7 March 2016
(This assessment supersedes the version issued on 24/11/15)

Client: Fire Combat Australia Pty Ltd t/a FireCrunch Australia

Commercial-in-confidence

Inquiries should be address to:

Fire Testing and Assessments	Author	The Client
NATA Register Laboratory	Infrastructure Technologies	Fire Combat Australia Pty Ltd t/a
14 Julius Avenue	14 Julius Avenue	FireCrunch Australia
North Ryde, NSW 2113	North Ryde, NSW 2113	Suite 19, Level 44, MLC Centre
Telephone +61 2 94905444	Telephone +61 2 94905500	19 Martin Place, Sydney NSW 2000
		Telephone +61 1300 795 774

Report Details:

Report CSIRO Reference number: FCO-3165/4632

Report Status and Revision History:

VERSION	STATUS	DATE	DISTRIBUTION	ISSUE NUMBER
Revision A	Draft for review	20/11/15	CSIRO/CLIENT	FCO-3165
Revision B	Final for issue	23/11/15	Client	FCO-3165
Revision C	Minor amendment	24/11/15	Client	FCO-3165
Revision D	Amendment	07/03/2016	Client	FCO-3165a

Report Authorization:

AUTHOR	REVIEWED BY	AUTHORISED BY
Brett Roddy	Chris Wojcik	Brett Roddy
		
7 March 2016	7 March 2016	7 March 2016

Copyright and disclaimer

© 2015 CSIRO To the extent permitted by law, all rights are reserved and no part of this publication covered by copyright may be reproduced or copied in any form or by any means except with the written permission of CSIRO.

Important disclaimer

This assessment report will lapse on 30 November 2020. Should you wish us to re-examine this report with a view to the possible extension of its term of validity, would you please apply to us three to four months before the date of expiry. This Division reserves the right at any time to amend or withdraw this assessment in the light of new knowledge.

CSIRO advises that the information contained in this publication comprises general statements based on scientific research. The reader is advised and needs to be aware that such information may be incomplete or unable to be used in any specific situation. No reliance or actions must therefore be made on that information without seeking prior expert professional, scientific and technical advice. To the extent permitted by law, CSIRO (including its employees and consultants) excludes all liability to any person for any consequences, including but not limited to all losses, damages, costs, expenses and any other compensation, arising directly or indirectly from using this publication (in part or in whole) and any information or material contained in it.

Contents

Executive summary	6
1 Introduction	7
2 Supporting Data	7
3 Proposal	7
4 Analysis.....	7
5 Conclusion	9
6 Term of validity	9
Appendix A - Supporting Data.....	10
A.1 CSIRO Sponsored Investigation report numbered FSV 1711b.....	10
Appendix B - Thermocouple locations	11
B.1 Unexposed face thermocouple locations	11
References.....	12

Executive summary

This Division has examined the information referenced by you on the likely performance of a loadbearing steel framed wall system lined with 10-mm thick FireCrunch MBE-10 boards incorporating mineral wool slabs used as cavity insulation.

Based on test data and the factors detailed in this report, it is the opinion of this Registered Testing Authority that the loadbearing framed wall system, identical to the system reported in CSIRO test report FSV 1711b would provide a fire-resistance level (FRL) of 90/90/90 if tested in accordance with AS 1530.4-2005 with the following provisions:

- The load applied to the wall system does not exceed 18.3 kN/m (maximum load applied to the tested prototype wall system);
- The wall cavity insulation comprises mineral wool slabs with a density of not less than 75 kg/m³;
- The wall cavity insulation is installed as a single piece to completely fill the wall void without through joints or gaps.

Likely fire performance of a loadbearing vertical separating element lined with FireCrunch MBE-10 boards incorporating cavity insulation.

1 Introduction

The fire performance of a steel framed loadbearing wall system lined on each side with FireCrunch MBE-10 magnesium oxide board has been the subject of a full scale fire-resistance test conducted in accordance with AS 1530.4-2005. This wall system incorporated two layers of Fletcher Insulation MW 450 mineral wool insulation slabs with a stated density of 64 kg/m³ installed within the wall cavity.

2 Supporting Data

A fire-resistance test has been conducted on a loadbearing steel framed wall system lined with FireCrunch MBE-10 magnesium oxide boards. This test report is described in Appendix A.

3 Proposal

The tested wall system incorporated two layers of Fletcher Insulation MW 450 mineral wool insulation slabs with a stated density of 64 kg/m³ installed within the wall cavity. It is proposed to increase the density of the cavity insulation to at least 75 kg/m³ to improve the insulation characteristics of the wall system during fire exposure.

4 Analysis

The tested prototype wall system comprised steel stud and noggin wall framing (90-mm x 45-mm x 1.0-mm BMT steel studs at 300-mm centres) lined with 10-mm thick FireCrunch MBE-10 wall linings. The wall system incorporated Fletcher Insulation (MW 450) mineral wool slabs with a density of 64 kg/m³ within the wall cavity.


The fire performance of the full scale loadbearing wall system has been reported in CSIRO test report FSV 1711b (appendix A), where the tested system maintained structural adequacy and integrity for the 98 minute duration of the test. The maximum temperature rise insulation failure criterion of 180K was exceeded at 89 minutes on the unexposed face of the specimen.

The insulation failure at this time was isolated to a single thermocouple (T/C 24 – Appendix B) positioned on the exposed face of the wall lining over a wall stud which exceeded 203°C at 89 minutes. The ambient temperature on the day of the test was 21°C. After 95 minutes of testing a maximum temperature of 202°C was recorded adjacent to a board joint on the unexposed face of the wall system (T/C 21 – Appendix B), 6 minutes after the first recorded failure.


The average temperature recorded on the unexposed face of the FireCrunch MBE-10 wall lining at the time of insulation failure measured 97°C and the maximum temperature measured at the head of the specimen was 146°C. Both of these recorded temperatures are below the average and maximum temperature rise failure criterion.

During construction of the test specimen the mineral wool slabs were installed in two layers, a 50-mm thick slab layer and a 40-mm thick slab layer installed back to back, used to fill the 90-mm deep wall cavity. An additional strip of 90-mm thick insulation material was cut to size and used to infill the steel stud frame sections (photograph 1).

The insulation installation method resulted in a through vertical joint between the mineral wool slabs at the intersection of the insulation strip used within the stud profile and insulation slabs (40-mm and 50-mm thick slabs) installed within the wall cavity (Photograph 2).

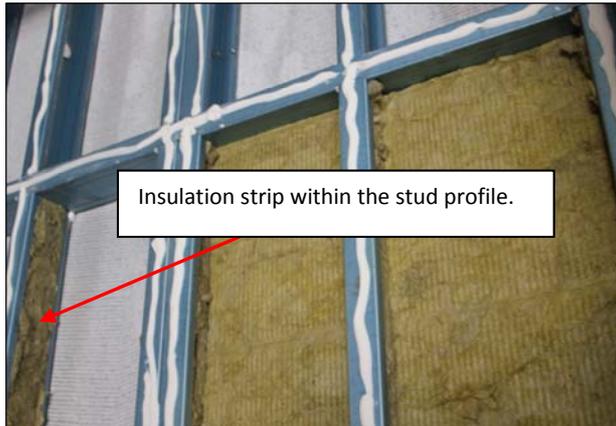

Photograph 1 – 90-mm thick strip of mineral wool insulation inserted within stud profile.

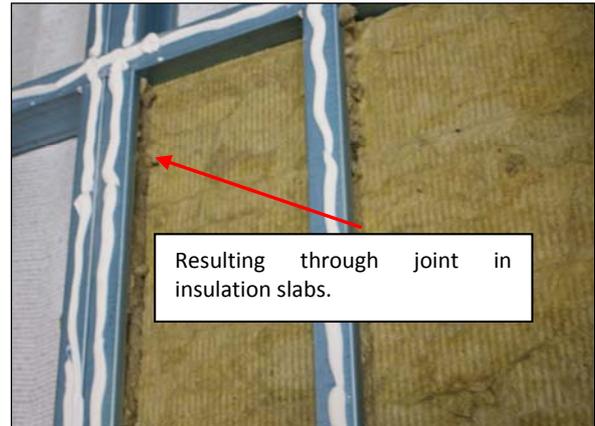

Photograph 2 – Vertical through joint in insulation slabs at intersection of 90-mm thick insulation strip in wall studs and 40-mm/50-mm slabs used in wall cavity.

The fire performance of the wall system is dependent on the exposed wall linings as well as the wall cavity insulation, which both contribute to delay the temperature rise of the wall framing and therefore the subsequent rise in temperature on the unexposed face of the specimen.

The presence of any through gap in the wall cavity insulation will allow the flow of hot furnace gases into the wall cavity when the exposed wall lining boards crack or the exposed board joints open up due to shrinkage and/or wall deflections.

One way to prevent this occurring within the wall cavity is to ensure that the insulation slabs are installed as a single piece without through joints. In addition to this, an increase in the density of mineral insulation used within the wall cavity will also provide additional insulation which will provide further protection to the wall cavity.

5 Conclusion

Based on test data and the factors detailed in this report, it is the opinion of this Registered Testing Authority that the loadbearing framed wall system, identical to the system reported in CSIRO test report FSV 1711b would provide a fire-resistance level (FRL) of 90/90/90 if tested in accordance with AS 1530.4-2005 with the following provisions:

- The load applied to the wall system does not exceed 18.3 kN/m (maximum load applied to the tested prototype wall system);
- The wall cavity insulation comprises mineral wool slabs with a density of not less than 75 kg/m³;
- The wall cavity insulation is installed as a single piece to completely fill the wall void without through joints or gaps.

6 Term of validity

This assessment report will lapse on 30 November 2020. Should you wish us to re-examine this report with a view to the possible extension of its term of validity, would you please apply to us three to four months before the date of expiry. This Division reserves the right at any time to amend or withdraw this assessment in the light of new knowledge.

Appendix A - Supporting Data

A.1 CSIRO Sponsored Investigation report numbered FSV 1711b

On the 21 September 2015 this Division conducted a full-scale fire-resistance test on load-bearing steel-framed wall system, lined on both sides with one layer of 10-mm thick MBE-10 FireCrunch magnesium oxide board. The specimen comprised a load-bearing framed wall system with overall nominal dimensions measuring 3000-mm high x 3000-mm wide x 110-mm thick.

The steel wall frame comprised eleven (11) 90-mm x 45-mm x 1.0-mm BMT steel studs fixed into top and bottom steel tracks with nominal dimensions of 90-mm x 45-mm x 1.0-mm BMT steel. The steel studs were spaced at nominal 300-mm centres, with two back to back (double) studs used at 600-mm centres to correspond with each of the FireCrunch MBE-10 board joints, as shown in drawing numbered 2, undated, by FireCrunch Australia Pty Limited.

Steel noggings, with nom. dimensions 90-mm x 45-mm x 1.0-mm BMT were screw fixed between the wall studs at 1000-mm vertical centres. The back to back (double) studs were first sealed at the a joining faces using PROMASEAL A acrylic sealant prior to being screw fixed together using 12-14 x 20-mm long hex head Tek screws at 400-mm centres. The remainder of the steel wall framing was screwed together using 10 gauge x 25-mm long steel screws.

The steel wall framing was lined on each face with a single layer of 10-mm thick FireCrunch MBE-10 magnesium oxide boards orientated vertically. The sheets measured nominally 1200-mm wide x 3000-mm long x 10-mm thick, with stated density of 950 kg/m³.

Prior to the wall boards being screw fixed to the wall studs, a nom. 10-mm wide x 3-mm deep bead of PROMASEAL A acrylic sealant was applied to the flanges of the tracks and studs and left to cure overnight. The FireCrunch MBE-10 boards were then screwed to the wall studs using 8-gauge x 25-mm long bugle head drywall screws at 200-mm centres, through pre-drilled holes 15-mm from the board edges. All board joints were offset by 600-mm. A nominal 3-mm gap was left between all board joints which were later sealed to the full board depth using PROMASEAL A acrylic sealant, and then taped and set using a setting compound.

The wall cavity was filled with two layers of Fletcher Insulation mineral wool insulation batts. The batts had a stated density of 64 kg/m³ and measured 1200-mm in length x 900-mm in width. One layer of 50-mm thick batts was laid against the exposed boards while the 40-mm thick batts were laid against the unexposed boards. Insulation strips were cut to fit within the metal studs.

A total load of 55 kN was applied to the specimen for the duration of the test.

The wall system failed with respect to insulation when the maximum temperature rise criterion of 180K was exceeded at 89 minutes on the unexposed face of the wall lining over a wall stud. The wall system maintained structural adequacy and integrity for 98 minutes at which time the test was terminated.

Appendix B - Thermocouple locations

B.1 Unexposed face thermocouple locations



Unexposed face of test specimen detailing external face thermocouple locations

References

The following informative documents are referred to in this Report:

AS

1530.4--2005 Methods for fire tests on building materials, components and structures Part 4:
Fire-resistance tests of elements of building construction.

CSIRO report

FSV 1711b Fire-resistance test on a loadbearing vertical separating element.

CONTACT US

t 1300 363 400
+61 3 9545 2176
e enquiries@csiro.au
w www.csiro.au

YOUR CSIRO

Australia is founding its future on science and innovation. Its national science agency, CSIRO, is a powerhouse of ideas, technologies and skills for building prosperity, growth, health and sustainability. It serves governments, industries, business and communities across the nation.

FOR FURTHER INFORMATION

Infrastructure Technologies

Mario Lara-Ledermann
Senior Fire Resistance and Assessments Engineer

t +61 2 94905500
e mario.lara@csiro.au
w www.csiro.au/Organisation-Structure/Divisions/CMSE/Infrastructure-Technologies/Fire-safety.aspx

Infrastructure Technologies

Brett Roddy
Manager, Fire Testing and Assessments

t +61 2 94905449
e brett.rodny@csiro.au
w www.csiro.au/Organisation-Structure/Divisions/CMSE/Infrastructure-Technologies/Fire-safety.aspx